

TEST REPORT
for Ingress Protection (IP68) Test carried out on
M16 CABLE GLAND

Customer:**AKSHAR BRASS INDUSTRIES**

Plot No 46,47,50, 51,

Survey No. 246,245,

at Naghedi Industrial Area,


Jamnagar - 361006, Gujarat, India.

Test Report No: E-3154-M**Discipline:** Electrical Testing**Group:** Environmental Test Facility**Sample Received Date:** 19.07.2021**ULR No.:** TC574321000014096F**Description of the Product:**

Product	Size
Cable Gland	M16

Date: 02nd August 2021**For ELCA LABORATORIES**
Authorised Signatory
Kartik Iyer / Hemant Ghare
C.E.O. / Senior Engineer


Page 1 of 7

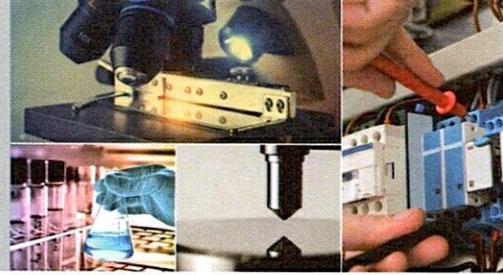

Continuation Sheet of Test report No: E-3154-M

CONTENTS

- 1.0 GENERAL TEST DESCRIPTION**
- 2.0 TEST DATA**
- 3.0 ENVIRONMENTAL CONDITIONS**
- 4.0 TEST CONDITIONS**
- 5.0 TEST RESULT**

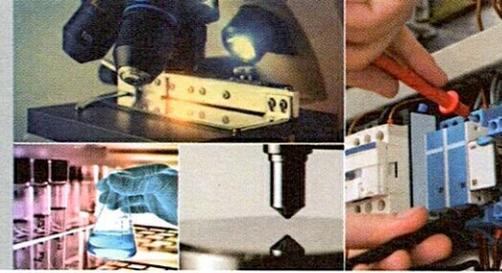
Continuation Sheet of Test report No: E-3154-M
1.0 GENERAL TEST DESCRIPTION

This Report presents the result of the Ingress Protection Test performed on M16 Cable Gland sample submitted by M/s. Akshar Brass Industries Sample is identified as **E-3154-M**.

Customer Challan No.: ABI/DC/015 dated 15.07.2021

Our Quotation / offer no.: ELCA/QUO/21-22/219/R1 dated 02.07.2021

Description of the Product:

Product	Size
Cable Gland	M16


All tests were carried out as per customer's requirements derived from the following standards.

APPLIED STANDARD: -
1. IEC 60529:2013
Degrees of Protection provided by enclosures (IP Code)

- a) Tests for protection of person against access to hazardous parts (First Numeral: 6)
as per Table No. 6 and Clause No. 12.2
- b) Tests for protection against solid foreign object (First Numeral: 6)
as per Table No. 7 and Clause No. 13.4
- c) Tests for protection against Water (Second Numeral: 8)
as per Table No. 8 and clause No. 14.2.8

Acceptance conditions:

- a) Tests for protection of person against access to hazardous parts
as per Clause No. 12.3
- b) Tests for protection against solid foreign object
as per Clause No. 13.6.2
- c) Tests for protection against Water
as per Clause No. 14.3

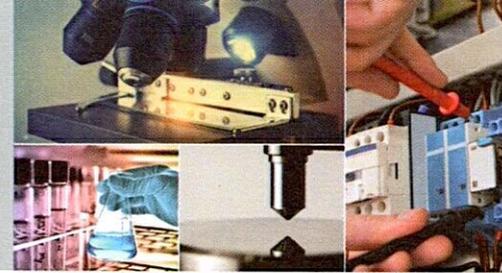

2.0 TEST DATA

Test Laboratory	ELCA LABORATORIES: Plot No. - Gen-62, TTC Industrial Area, MIDC, Mahape, Navi Mumbai - 400710.
Test Date	a) Test for protection of person against access to hazardous parts on 19 th July 2021. b) Test for protection against solid foreign object 19 th July 2021. c) Test for protection against Water on 21 st July 2021.
Tested By	Mr. Hemant Ghare
ELCA ID No.	E-3154-M


3.0 ENVIRONMENT CONDITIONS

Tests have been performed in a controlled laboratory environment, where the environmental conditions are maintained within the applicable ranges as follows.

Ambient Temperature	15°C - 35°C
Relative Humidity air	25% - 75%
Air pressure	86 kPa to 106 kPa (860 mbar to 1 060 mbar)

4.0 EQUIPMENT USED

TEST	Equipment Used	ELCA ID	Calibration Due on
Ingress Protection Test (IP6X)	Rigid Steel Rod of 1.0 mm dia. Object Probe	IPD/04	28.07.2021
	Dust Chamber	ENV/006	16.03.2022
	U Tube Vacuum Gauge Manometer	ENV/008	08.10.2022
Ingress Protection Test (IPX8)	Water Tank	--	--

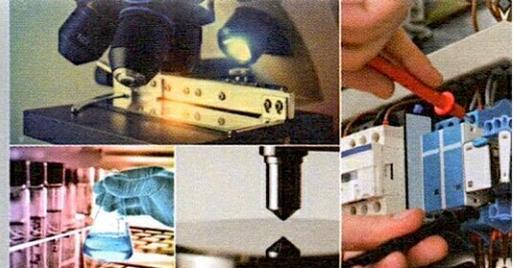

5.0 TEST CONDITIONS

Degrees of protection of person against Access to Hazardous parts as per Table 6

The sample was tested for protection against Access

Equipment Used	Rigid Steel Rod of 1.0 mm dia. Object Probe
Equipment ID	IPD/04
IP code	First Characteristic numeral: 6

Degree of protection against solid foreign object as per Table 7

The sample was placed in the Dust Chamber at room temperature. The test conditions are as follows: -


Exposure Period	8 Hours at 20 mbar
Start time	09.15 AM on 19.07.2021
End time	05.15 PM on 19.07.2021
Equipment used	ENV/026
IP code	First Characteristic numeral: 6 Category: 1

Type of dust used	Talcum powder
Size of dust	Passed through square meshed sieve of wire diameter 50µm and nominal width of a gap between wires 75 µm
Weight of dust used	2 kg. (2kg.per cubic meter of test chamber)
Chamber volume	1.0 cubic meter

Degrees of protection against water as per Table 8


The sample was tested for water test as per following conditions:

Equipment used	Water Tank
Location of the samples	Lowest point of enclosure is located at 1.5 meter below the surface of the water
Start time	10.00 AM dated 21.07.2021
End time	11.00 AM dated 21.07.2021
Duration of test	60 Minutes
IP code	Second Characteristic numeral: 8

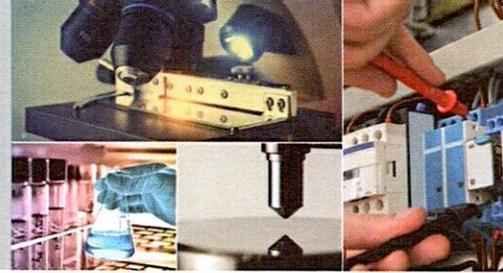



Continuation Sheet of Test report No: E-3154-M

The sample inside the chamber after protection against solid foreign object (dust test) was seen as follows:

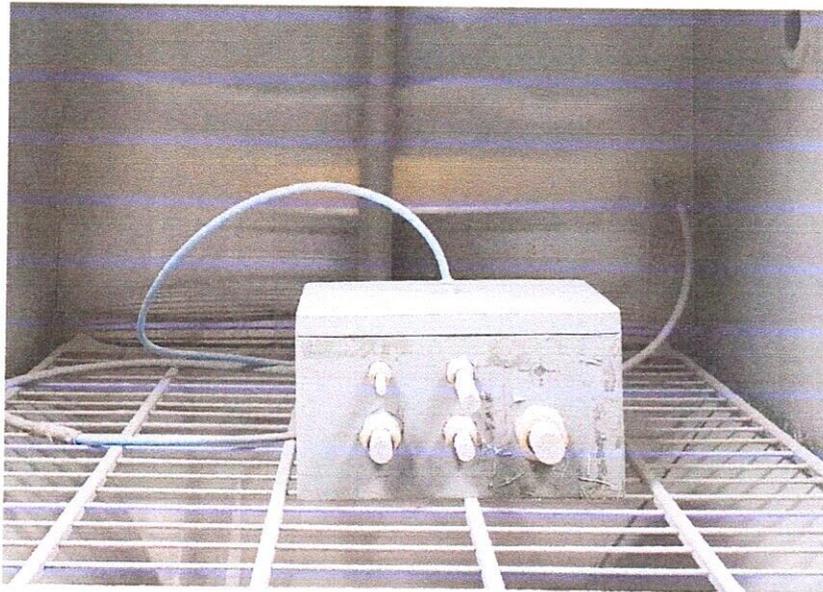


The sample during water test was seen as follows:

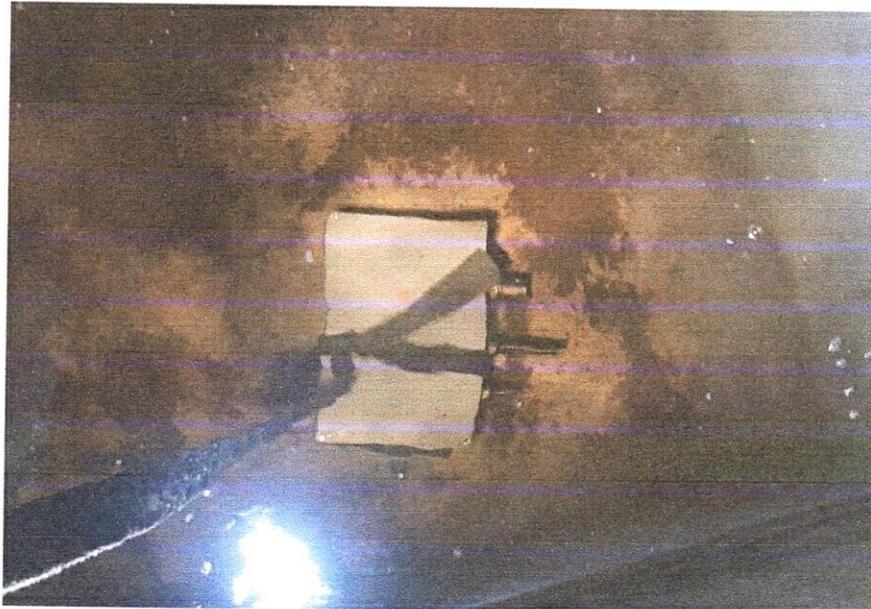

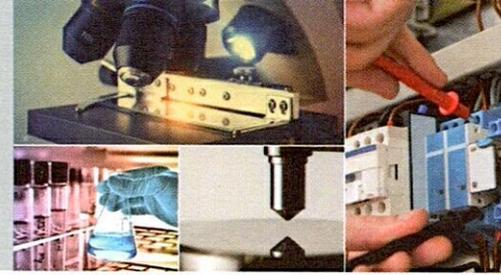
Continuation Sheet of Test report No: E-3154-M

The sample after dust test and water was seen as follows:

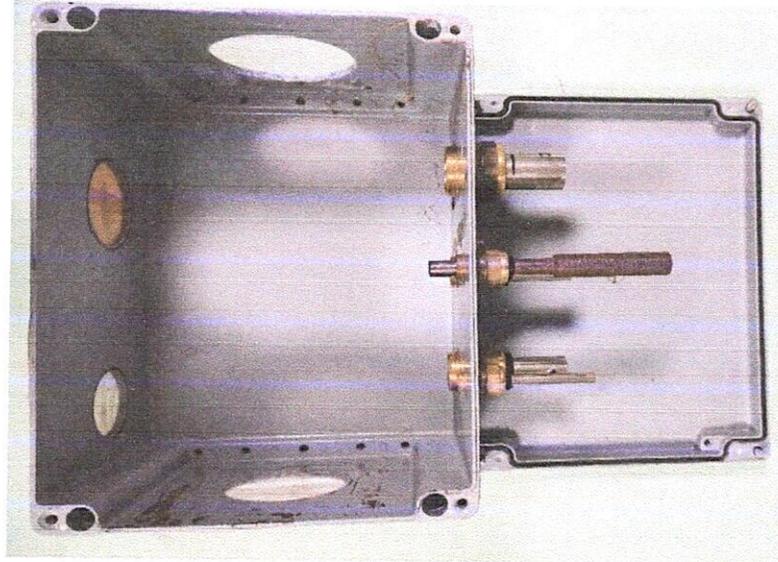

The IP test procedure is based on IEC 60529 (Degrees of Protection provided by enclosures (IP Code)). After the completion of each test sample was visually inspect.


5.0 TEST RESULT: -

Name of test	Observations after test
Tests for protection of person against access to hazardous parts (Probe Test)	Full diameter of probe did not pass through any opening.
Tests for protection against solid foreign object (Dust Test)	No dust was observed inside the sample.
Tests for protection against Water	No water observed inside the sample.
Result: Sample complies with test requirements of IP68 as per IEC 60529:2013.	

-----END-----OF-----REPORT-----

Checked By: 

For ELCA LABORATORIES


 Authorised Signatory
 Kartik Iyer / Hemant Ghare
 C.E.O./ Senior Engineer

Page 7 of 7