

TEST REPORT
for Ingress Protection (IP67) Test carried out on
DOUBLE COMPRESSION CABLE GLAND E1W-20s

Customer:**AKSHAR BRASS INDUSTRIES**

Plot No 46,47,50, 51,


Survey No. 246,245,

at Naghedi Industrial Area,

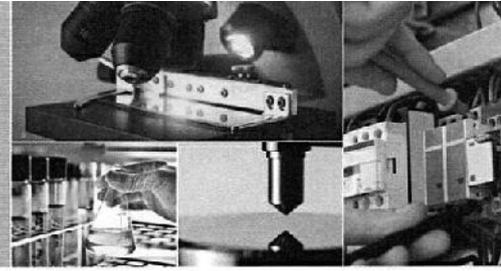
Jamnagar - 361006, Gujarat, India.

Test Report No: E-3193-M**Discipline:** Electrical Testing**Group:** Environmental Test Facility**Sample Received Date:** 13.08.2021**ULR No.:** TC574321000016410F**Description of the Product:**

Product	Size
Double Compression Cable Gland	E1W-20s

Date: 30th August 2021**For ELCA LABORATORIES****Reviewed & Authorised by**
Authorised Signatory
Kartik Iyer / Hemant Ghare
C.E.O. / Senior Engineer**Harshali Chaudhari**
Checked by

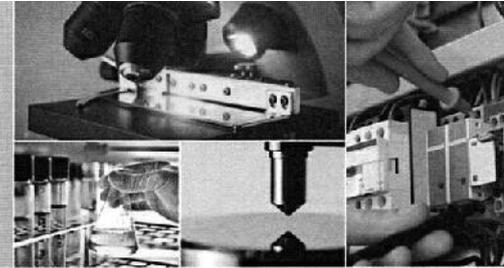
Page 1 of 7



Continuation Sheet of Test report No: E-3193-M

CONTENTS

- 1.0 GENERAL TEST DESCRIPTION**
- 2.0 TEST DATA**
- 3.0 ENVIRONMENTAL CONDITIONS**
- 4.0 EQUIPMENT USED**
- 5.0 TEST CONDITIONS**
- 6.0 TEST RESULT**


Continuation Sheet of Test report No: E-3193-M
1.0 GENERAL TEST DESCRIPTION

This Report presents the result of the Ingress Protection Test performed on Double Compression Cable Gland E1W-20s sample submitted by M/s. Akshar Brass Industries Sample is identified as **E-3193-M**.

Customer Challan No.: Nil dated 11.08.2021

Our Quotation / offer no.: ELCA/QUO/21-22/394 dated 14.08.2021

Description of the Product:

Product	Size
Double Compression Cable Gland	E1W-20s

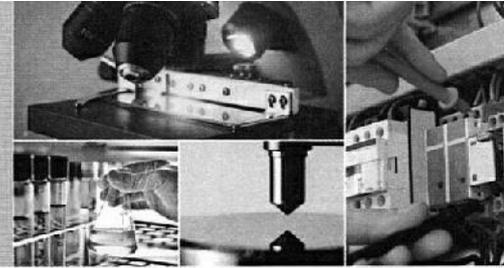
All tests were carried out as per customer's requirements derived from the following standards.

APPLIED STANDARD: -
1. IEC 60529:2013
Degrees of Protection provided by enclosures (IP Code)

- a) Tests for protection of person against access to hazardous parts (First Numeral: 6) as per Table No. 6 and Clause No. 12.2
- b) Tests for protection against solid foreign object (First Numeral: 6) as per Table No. 7 and Clause No. 13.4
- c) Tests for protection against Water (Second Numeral: 8) as per Table No. 8 and clause No. 14.2.7

Acceptance conditions:

- a) Tests for protection of person against access to hazardous parts as per Clause No. 12.3
- b) Tests for protection against solid foreign object as per Clause No. 13.6.2
- c) Tests for protection against Water as per Clause No. 14.3


Continuation Sheet of Test report No: E-3193-M
2.0 TEST DATA

Test Laboratory	ELCA LABORATORIES: Plot No. - Gen-62, TTC Industrial Area, MIDC, Mahape, Navi Mumbai - 400710.
Test Date	a) Test for protection of person against access to hazardous parts on 23 rd August 2021. b) Test for protection against solid foreign object 23 rd August 2021. c) Test for protection against Water on 24 th August 2021.
Tested By	Mr. Hemant Ghare
ELCA ID No.	E-3193-M

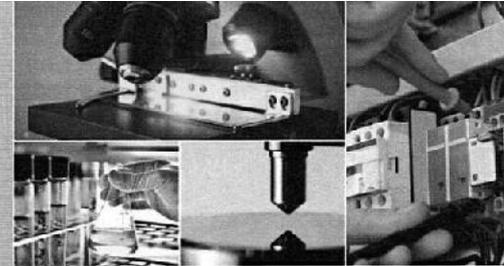
3.0 ENVIRONMENT CONDITIONS

Tests have been performed in a controlled laboratory environment, where the environmental conditions are maintained within the applicable ranges as follows.

Ambient Temperature	15°C - 35°C
Relative Humidity air	25% - 75%
Air pressure	86 kPa to 106 kPa (860 mbar to 1 060 mbar)

4.0 EQUIPMENT USED

TEST	Equipment Used	ELCA ID	Calibration Due on
Ingress Protection Test (IP6X)	Rigid Steel Rod of 1.0 mm dia. Object Probe	IPD/04	24.7.2022
	Dust Chamber	ENV/026	--
	Digital Timer (Dust Chamber)	ENV/026/01	16.03.2022
	Pressure Gauge (Dust Chamber)	ENV/026/02	19.03.2022
	Vacuum Gauge (Dust Chamber)	ENV/026/03	19.03.2022
Ingress Protection Test (IPX7)	Water Tank	--	--


5.0 TEST CONDITIONS
Degrees of protection of person against Access to Hazardous parts as per Table 6

The sample was tested for protection against Access

Equipment Used	Rigid Steel Rod of 1.0 mm dia. Object Probe
Equipment ID	IPD/04
IP code	First Characteristic numeral: 6

Degree of protection against solid foreign object as per Table 7

The sample was placed in the Dust Chamber at room temperature. The test conditions are as follows: -

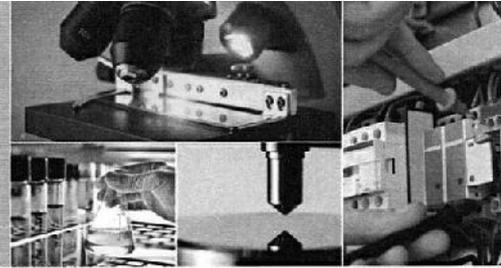
Exposure Period	8 Hours at 20 mbar
Start time	10.00 AM on 23.08.2021
End time	06.00 PM on 23.08.2021
IP code	First Characteristic numeral: 6 Category: 1

Type of dust used	Talcum powder
Size of dust	Passed through square meshed sieve of wire diameter 50µm and nominal width of a gap between wires 75 µm
Weight of dust used	2 kg. (2kg.per cubic meter of test chamber)
Chamber volume	1.0 cubic meter

Degrees of protection against water as per Table 8

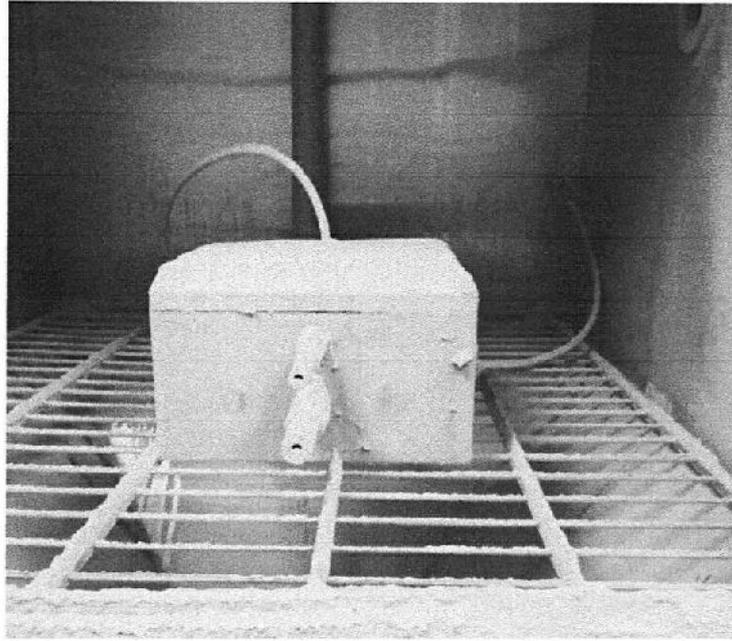
The sample was tested for water test as per following conditions:

Equipment used	Water Tank
Location of the samples	Lowest point of enclosure is located at 1.5 meter below the surface of the water
Start time	12.00 AM dated 24.08.2021
End time	12.30 AM dated 24.08.2021
Duration of test	30 Minutes
IP code	Second Characteristic numeral: 7

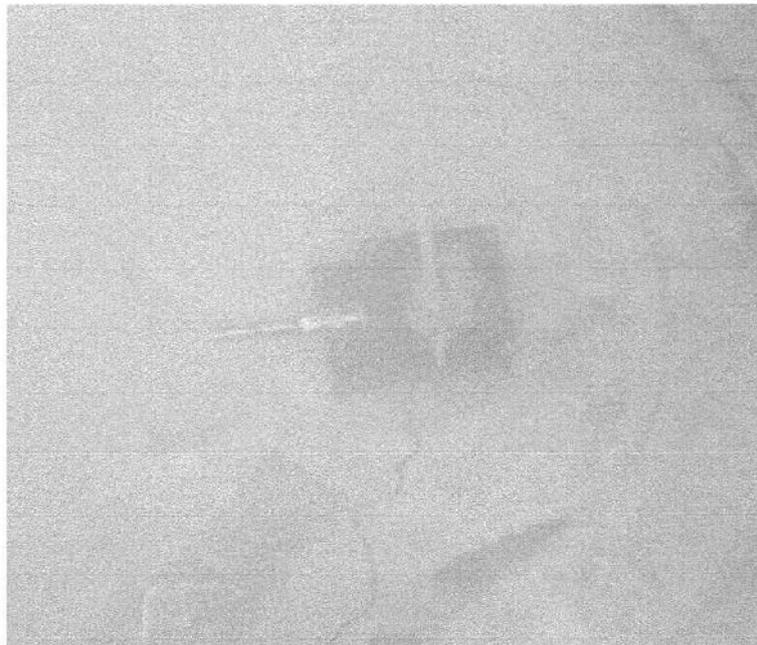


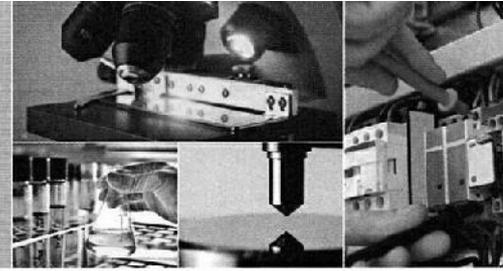
Continuation Sheet of Test report No: E-3193-M

The sample inside the chamber after protection against solid foreign object (dust test) was seen as follows:

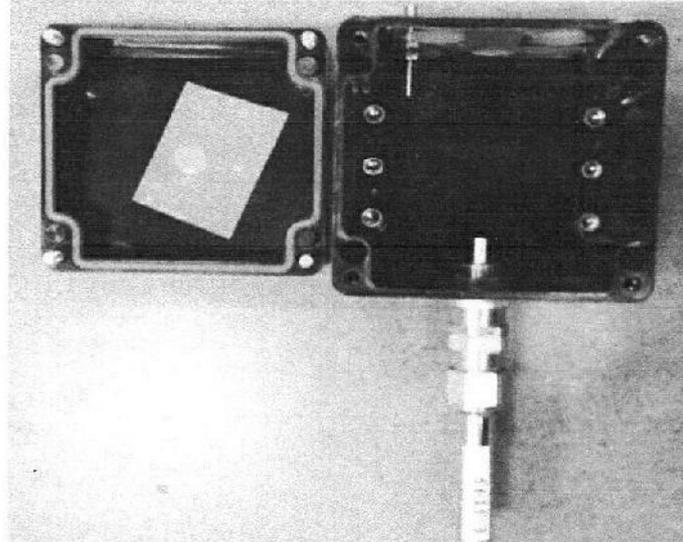


The sample during water test was seen as follows:




Continuation Sheet of Test report No: E-3193-M

The sample after dust test and water was seen as follows:




The IP test procedure is based on IEC 60529 (Degrees of Protection provided by enclosures (IP Code)). After the completion of each test sample was visually inspect.

5.0 TEST RESULT: -

Name of test	Observations after test
Tests for protection of person against access to hazardous parts (Probe Test)	Full diameter of probe did not pass through any opening.
Tests for protection against solid foreign object (Dust Test)	No dust was observed inside the sample.
Tests for protection against Water	No water observed inside the sample.
Result: Sample complies with test requirements of IP67 as per IEC 60529:2013.	

-----END-----OF-----REPORT-----


Harshali Chaudhari
 Checked by

For ELCA LABORATORIES

 Reviewed & Authorised by
 Authorised Signatory
Kartik Iyer / Hemant Ghare
 C.E.O. / Senior Engineer

Page 7 of 7