
2

- 8. Any modification which differs from the condition as delivered is not permitted.
- 9. Accessories are available from CABTEK, as optional extras, to assist with fixing, sealing and earthing, Locknut, Earth Tag, Serrated Washer, Entry Thread seal (IP), Shroud.

Special Condition of Safe Use of Cable Glands:

- Cable Glands are only suitable for fixed installations.
- 2. Cable must be effectively clamped from pulling and twisting.
- 3. Cable Glands shall not be used in enclosure where the temperatures at the point of entry /mounting are outside the range of ambient temperatures as detailed in general description.
- The glands should only be used with substantially round cables and tightened to the rated torque with torque wrenches.
- 5. Install in accordance with requirements of EN60079-14.
- The cable glands are provided with a sealing ring with an axial sealing height of at least 5 6. mm. With reference to the clearance groove, the end-user should ensure that at least five complete turns of the connector thread are made. In order to guarantee a screw depth of 8 mm, the enclosure should have a wall thickness of min. 10mm; if <10 mm, then if necessary, use a washer when cable entries are attached to the pressure-resistant enclosure.
- In the case of NPT connecting threads, the end-user must ensure that the necessary IP protection is guaranteed; this can be done using a suitable thread sealing agent.

Installation should not be carried out under live conditions. CABLE GLAND ORDERING DETAILS:

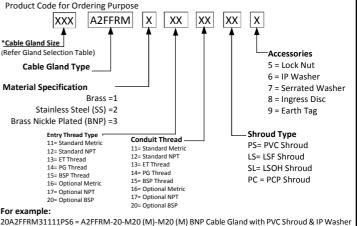

20A2FFRM31111PS569 = A2FFRM-20-M20 (M)-M20 (M) BNP Cable Gland PS Kit* (*Kit includes PVC Shroud(PS), Lock Nut(5), IP Washer(6) & Tag(9)

4 Determine the conductor length required to suite the equipment and prepare the cable accordingly. Remove the Outer sheath of cable as per requirement to see the insulated conductors and pass through cable gland.

4

5 Tighten the seal nut by hand until resistance is felt and then tighten further one full turn with spanner as instructed torque.



6 Attach the conduit to the conduit coupler and fully tighten. Ensure that the seal nut does not come loose during this process by holding it with a spanner.



Warning:

Please study carefully these instructions before installation. These glands should not be used in any application other than those mentioned here, unless CABTEK states in writing that the product is suitable for such application. CABTEK will not take any responsibility for any damage, injury or other consequential loss caused where the glands are not installed or used according to installation instructions. This leaflet is not intended to advice on the selection of cable glands. Installation must be carried out by a competent electrician, skilled in cable gland installation. Installation should not be carried out under live conditions.

Customer Care:

For any more information regarding please send your query to us by mail or telephone number

AKSHAR BRASS INDUSTRIES

Tel.: + 91-76006 16887, 94277 71205

CABTEK

Email: info@aksharbrassind.com, Website: www.aksharbrassind.com


Installation Manual for A2FFRM Cable Gland A2FFRM Flameproof Cable Gland for Unarmoured Cables with conduit fitting Please read all instructions carefully before beginning the installation CABTEK A2FFRM type Cable Glands are for Indoor and Outdoor use in the appropriate Hazardous areas with unarmored cable. The seal on the outer jacket and give environmental protection to IP66/67. Glands are suitable for normal industrial environmental of temperature, humidity and vibration. Cable Glands are made of Brass CW614N/SS 316L assembled with VMQ Silicone Rubber and Nylon Substrate. Material Compatibility under chemical corrosion or attack by aggressive substance must be considered before installation. Cable Gland confirm to following Standards for Group II, Category-2 for Zone 1, 2, 21 & 22 for ambient temperature range -60°C to +135°C. Standards Applied: EN IEC 60079-0:2018 EN/IEC 60079-1:2014 EN/IEC 60079-31:2014/2013 Ex marking on A2FFRM type Cable Glands: CABTEK 20A2FFRM-M20(M)-M20(M) (x) II 2 GD C E 2903 Ex db IIC Gb, Ex eb IIC Gb Ex tb IIIC Db IP66/67..... -60°C to +135°C, ETL22ATEX0109X, IECEx ITS 16.0041X..... RU C-IN. #58. B. 03310/22, P568411/1..... Installation Guide: 1. Installation must be carried out by a competent electrician, skilled in cable gland installation. 2. Installation should not be carried out under live conditions. 3. Once installed do not dismantle except for occasional inspection. If necessary, dismantle by reverting the installation instruction. The gland is not serviceable and spare parts are not supplied separately. 4. Parts of glands are not interchangeable with any other design. If manufacturer's parts are mixed, certification will be invalidated. 5. The female thread in the enclosure must comply with relevant standard and do not damage threads on assemblies. 6. The glands should only be used with substantially round and compact cables with correct tools 7. Installation should only be performed by a competent person using the correct torque tools. Spanners should be used for tightening. Read all instructions before beginning installation. 3 For cable gland technical details like Cable Gland Size, Cable diameter, thread and torque details given as below. Cable Gland Selection Table for Fig 5 to 9 Standard Entry Thread "C" ly Length
 Thread °C*
 Metric
 NPT
 Optional
 Range
 Flat cable

 Metric
 NPT/SSP
 ET
 PG
 Length*0*
 Length*0*
 Metric
 NPT/SSP
 Min
 Max
 Metric

 M20x1.5
 J.2*
 J.4*
 pG13.5
 15.00
 16.00
 M25x1.5
 3.4*
 4x6.2
 6.8x1.7
 J
A/I A/C 26.20 32.75 27.30 M20x1.5 1/2" 3/4" PG16 15.00 16.00 M25x1.5 3/4" 5.7x8 8.7x13.5 27.00 29.50 1 33.00 27.80
 Jo
 Mounds
 Jul
 System
 Full
 Status
 Handle
 Mexistical
 System
 System 27.00 29.50 29.50 33.00 27.80 40 6 27.00 33.00 27.80 2 36.00 39.20 38.50 36.80 45 36.00 39.20 45.00 38.50 36.80 45 55 3 41.00 45.00 40.00 INSTALLATION INSTRUCTIONS FOR CABLE GLAND TYPES A2FFRM 1.

It is not necessary to separate components of the cable gland any further

than illustrated below.



2. Check the seal in the entry component and it is in a relaxed state by loosening the outer seal nut.



Fit the complete cable glands to the enclosure. Use the thread seals to 3. maintain the IP rating of equipment and cable glands. Hand-tighten then use wrench to tighten a further. DO NOT EXCEED MAX TORQUE FOR ENCLOSURE. The surface of the enclosure should be sufficiently flat and rigid to make both the IP joint and a suitable earth connection (if required). In the case of painted enclosures, serrated washer should be fitted to break through the paint and make satisfactory earth contact. Secure the complete gland into the enclosure by the outer seal nut.

